



## **HCM Installation Instructions**

### **1.0 SCOPE**

This document provides installation instruction on Horizontal Cable Manger.

### **2.0 PRODUCT DESCRIPTION**


This is 1U & 2U Horizontal cable manger.

### **3.0 PROCEDURE**


#### **3.1 ASSEMBLY INSTRUCTIONS**

### **1U & 2U Horizontal Cable Manger**

(For RAA-00002/Equivalent EIA 19" Standard Open Bay Racks)

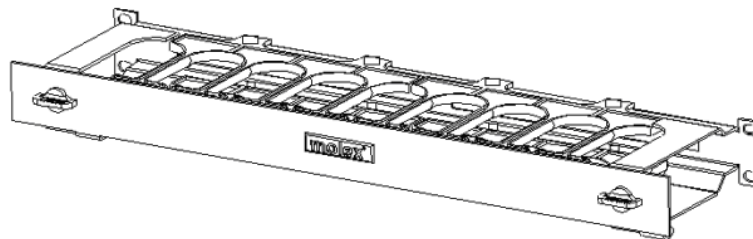

**1U HCM, CMA-00085**

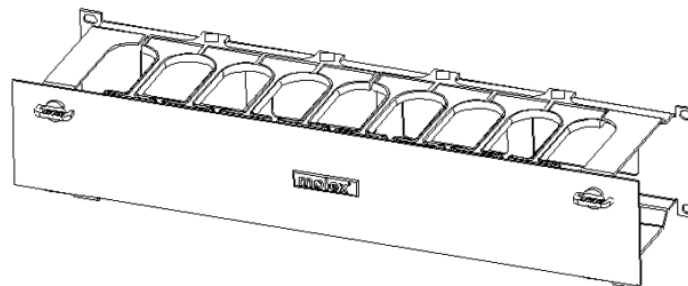

**2U HCM, CMA-00087**


EC/ECM NO: <b>115310</b>	SAP NO : <b>187000319</b>	Doc No: <b>AS-A8700-038</b> Doc part: <b>AS</b>	REV- <b>A2</b>
SAP EC NO: <b>10832335</b>	<a href="http://www.molexces.com/">http://www.molexces.com/</a>		DATE: <b>2017/MAY/11</b>

## 1. Parts List for 1 U and 2 U Horizontal Cable Manager

- a. Pre-Assembled 1 U or 2 U Horizontal Cable Manager x 1Pc
- b. 1 U or 2 U Door Assembly x 1 Pc
- c. CUP WASHER x 4 Pc
- d. SCREW M6X16 CH HD SLT CHEM BLK x 4Pc
- e. CAGED NUT M6 SMG 06/1/71/448' x 4Pc
- f. Black Washer x 4 Pc
- g. 12-24 x 1/2 PHIL PHMS BLACK SCREW x 4 Pc


## 2. Installation of 1 U and 2 U Horizontal Cable Manager

The CMA-00085/87 can be used in-conjunction with the Molex RAA-00002 or an EIA equivalent 19 Inch Rack

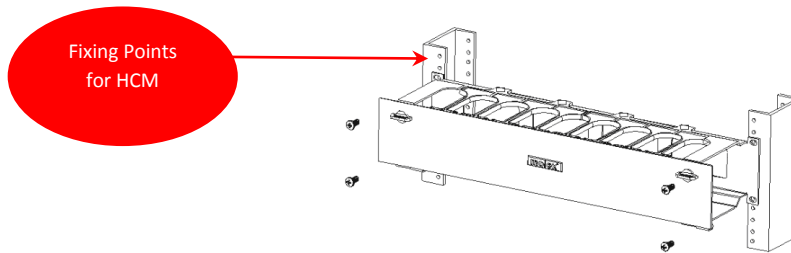

- Align holes on fixing plate of the Horizontal Cable Manager with screw holes at the desire position on the open bay rack, making sure all 4 holes are aligned and clear to fit screw.
- Install the HCM to the open rack with the screws provided.

## 3. Securing HCM door to the HCM

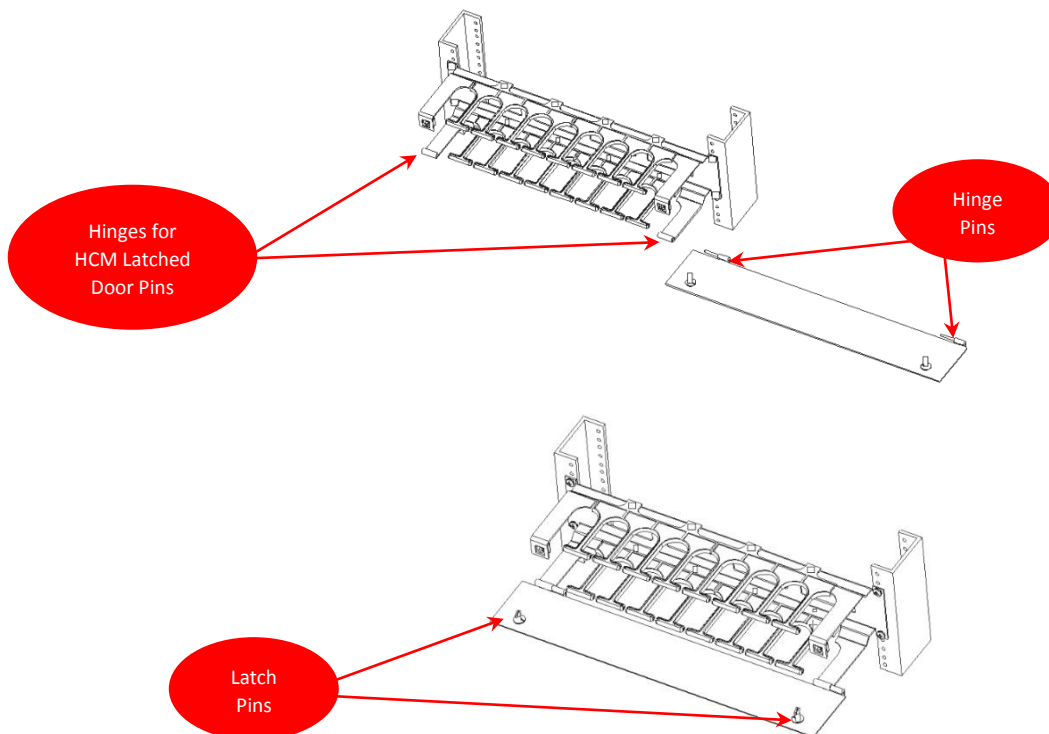

- Having installed the HCM to the rack allows for both free hands to secure the door.
- To installed the HCM Latched Door slide the Hinge Pins into the Hinge on the body of the HCM
- To lock the door move upwards and with align door with latch pin holes on the body of the HCM
- Activate latch pins by folding pins down

## 4. Opening of HCM Door

1. Open door by deactivating Latch Pins and fold door downwards